


REVISION	DATE	CHANGE NO.
1	06.76	5
2		4
3		3
4		2
5		1

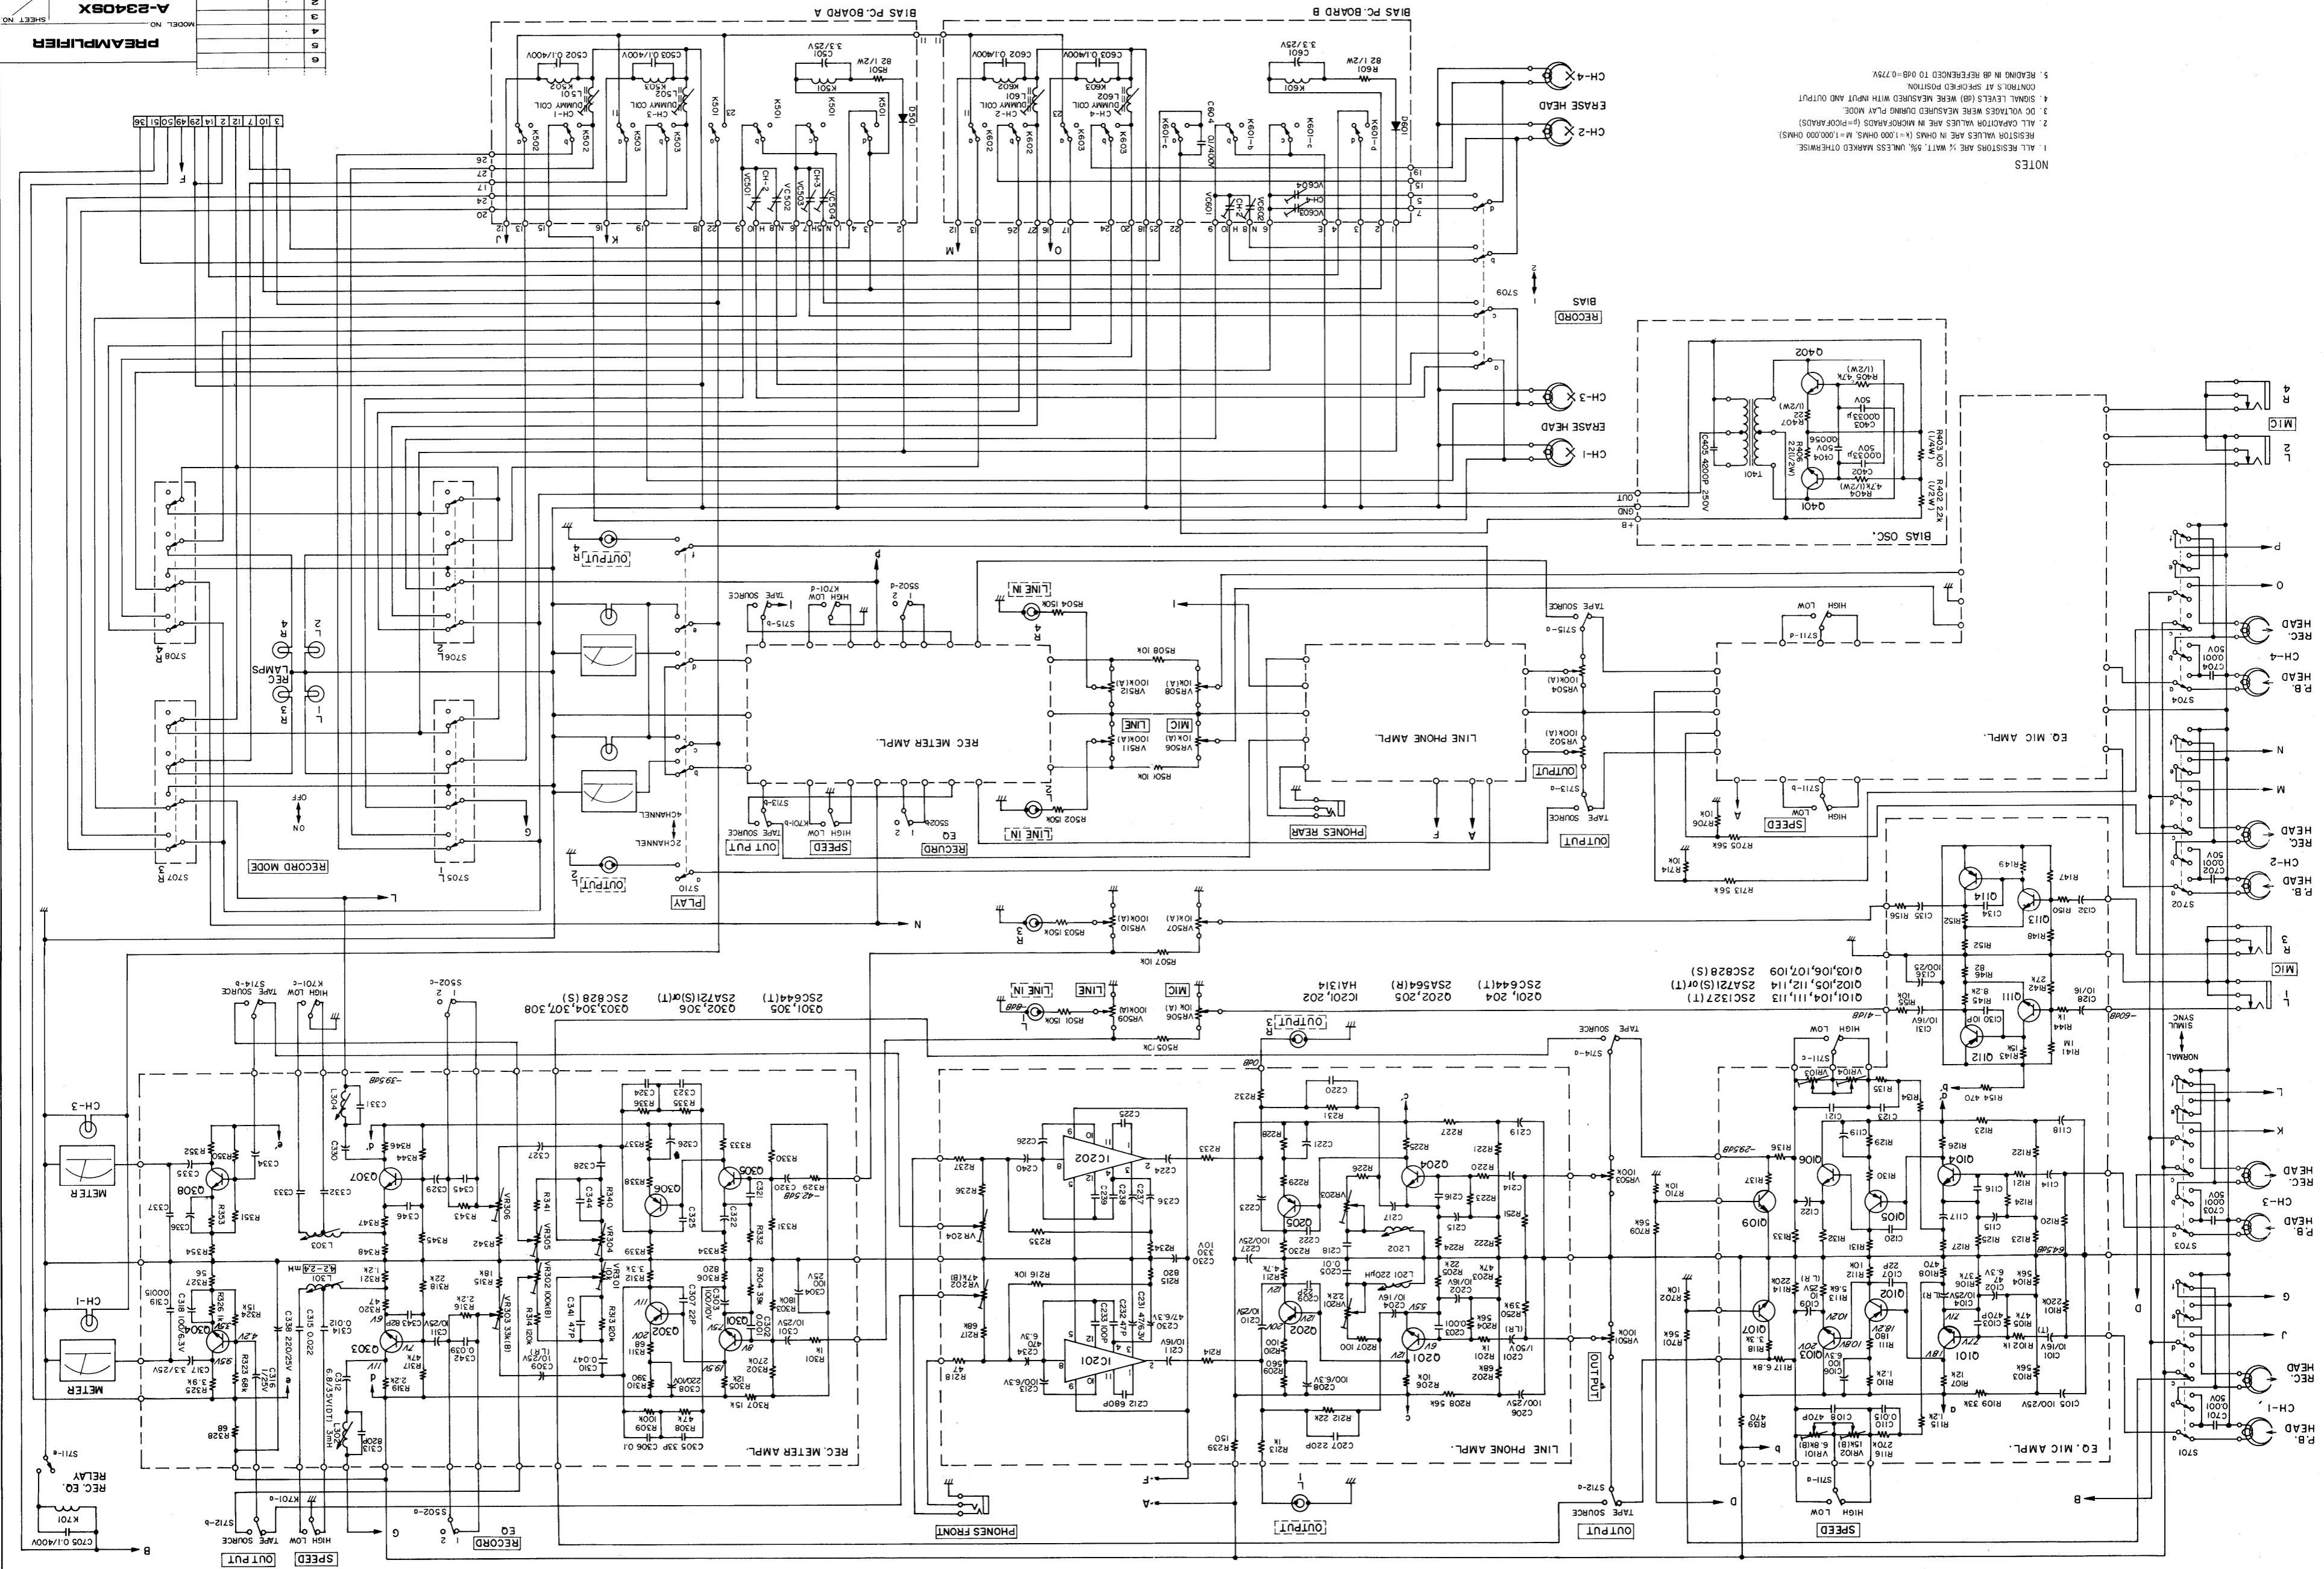

- NOTES
1. ALL RESISTOR VALUES ARE IN OHMS (K=1,000 OHMS, M=10,000 OHMS).
  2. ALL CAPACITOR VALUES ARE IN MICROFARADS (μ=1000 FARADS).
  3. DO NOT REMOVE WIRE MEASURED QUANTUM PLUM MODES.
  4. SIGNAL LEVELS (dB) WERE MEASURED WITH INPUT AND OUTPUT CONTROL AT SPECIFIED POSITION.
  5. RESISTOR IN DB REFERENCED TO 0dB=0.775V.